



PLAN VIEW

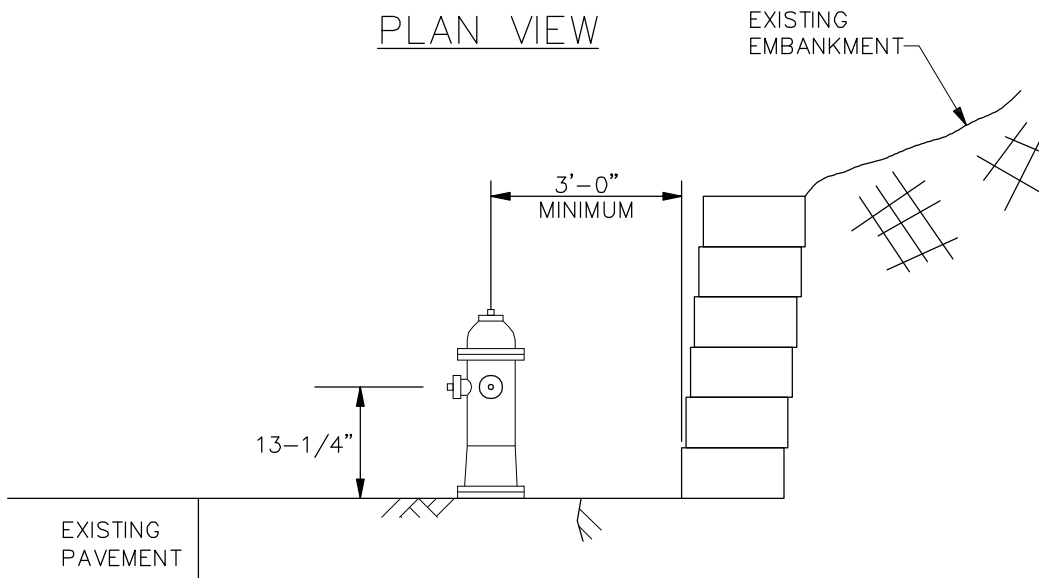

SECTION A-A

NOTE:

1. RETAINING WALL TO BE PROVIDED WHEN FIRE HYDRANT SETTING REQUIRES EXCAVATION INTO EXISTING EMBANKMENT
2. NO PART OF ANY FIRE HYDRANT SETTING SHALL BE CLOSER THAN 5'-0" TO ANY DRIVEWAY, SEWER INLET, UTILITY POLE OR ANCHOR WIRE.
3. KEYSTONE RETAINING WALL SYSTEM - STD. UNIT OR INDIAN HILL WATER WORKS APPROVED EQUAL



VILLAGE OF INDIAN HILL  
DEPARTMENT OF WATER WORKS

APPROVED *[Signature]*  
DATE November 2011

STANDARD  
HYDRANT SETTINGS

DRAWING NO.

WW-125